



LEGEND:

 FIRE EXTINGUISHER

**R&D.C.**  
FIRE EXTINGUISHERS


FIRST FLOOR PLAN

Station No.	Equipment Type	Class Hazard
1-1E	10# CO2	A B C
2-1E	2-1/2 Gal. P.W.	A B C
3-1E	15# CO2	B C
5-1E	10# CO2	B C
6-1E	10# CO2	B C
7-1E	10# Dry Chem.	A B C
8-1E	10# CO2	B C
10-1E	10# CO2	B C
11-1E	5# CO2	B C
12-1E	2-1/2 Gal. P.W.	A
13-1E	5# CO2	B C
14-1E	20# CO2	B C
15-1E	20# Dry Chem.	A B C
16-1E	10# CO2	B C
17-1E	15# CO2	B C
19-1E	1-1/2 Gal. P.W.	A

BUILDING No:

**003**

2009 FIRE EXTINGUISHER INSPECTION PLAN

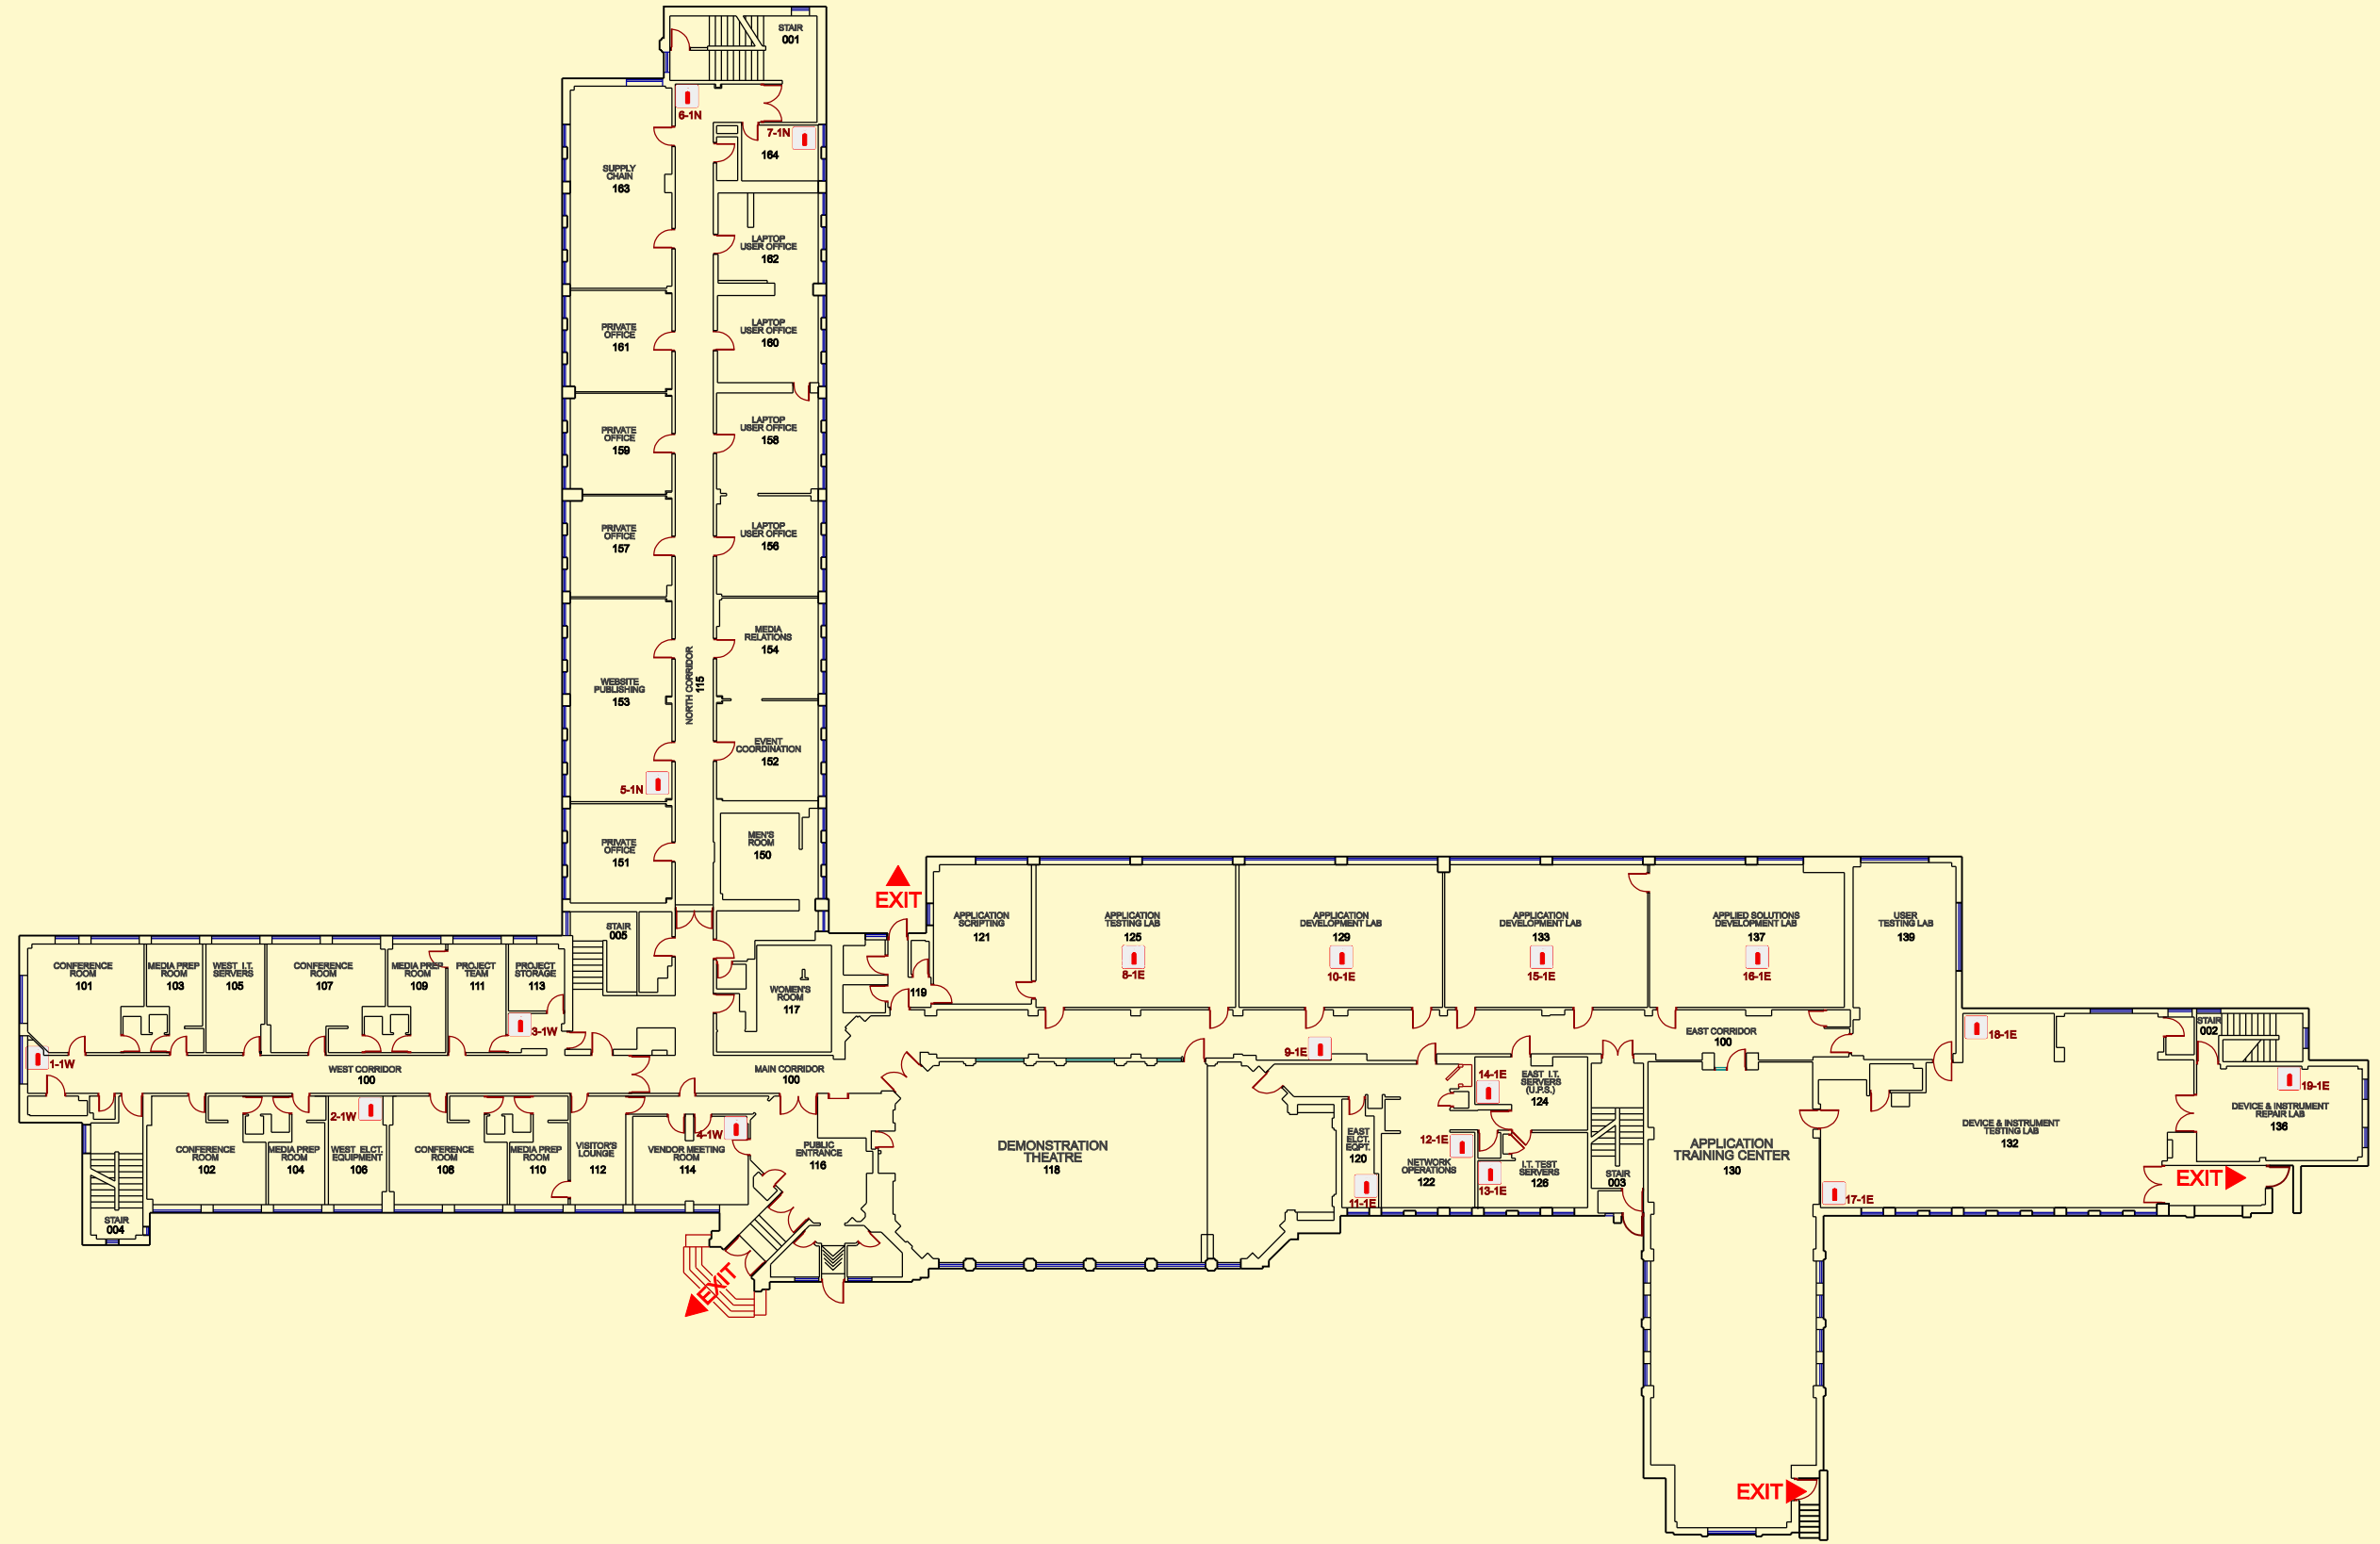

(N.T.S.)

FIRST FLOOR PLAN  
INTEGRATED SOLUTIONS INSTITUTION  
RESEARCH & DEVELOPMENT CENTER