




LEGEND:

■ LOCATION OF CMMS EQUIPMENT

R&D.C.

CMMS EQUIPMENT SCHEDULE

Building System	Eqpt. Type	Eqpt. I.D. #	Location	Eqpt. Description
ELCT	UPSX	0001	Room 120	Uninterruptible Power System
HVAC	CHLR	0001	Room 124	Chiller
HVAC	CHLR	0002	Room 126	Chiller
HVAC	CHLR	0003	Roof Top	Chiller
HVAC	CHLR	0004	Roof Top	Chiller
HVAC	MUAH	0005	Roof Top	Make-Up Air Handler
HVAC	HRCV	0006	Roof Top	Heat Recovery Unit

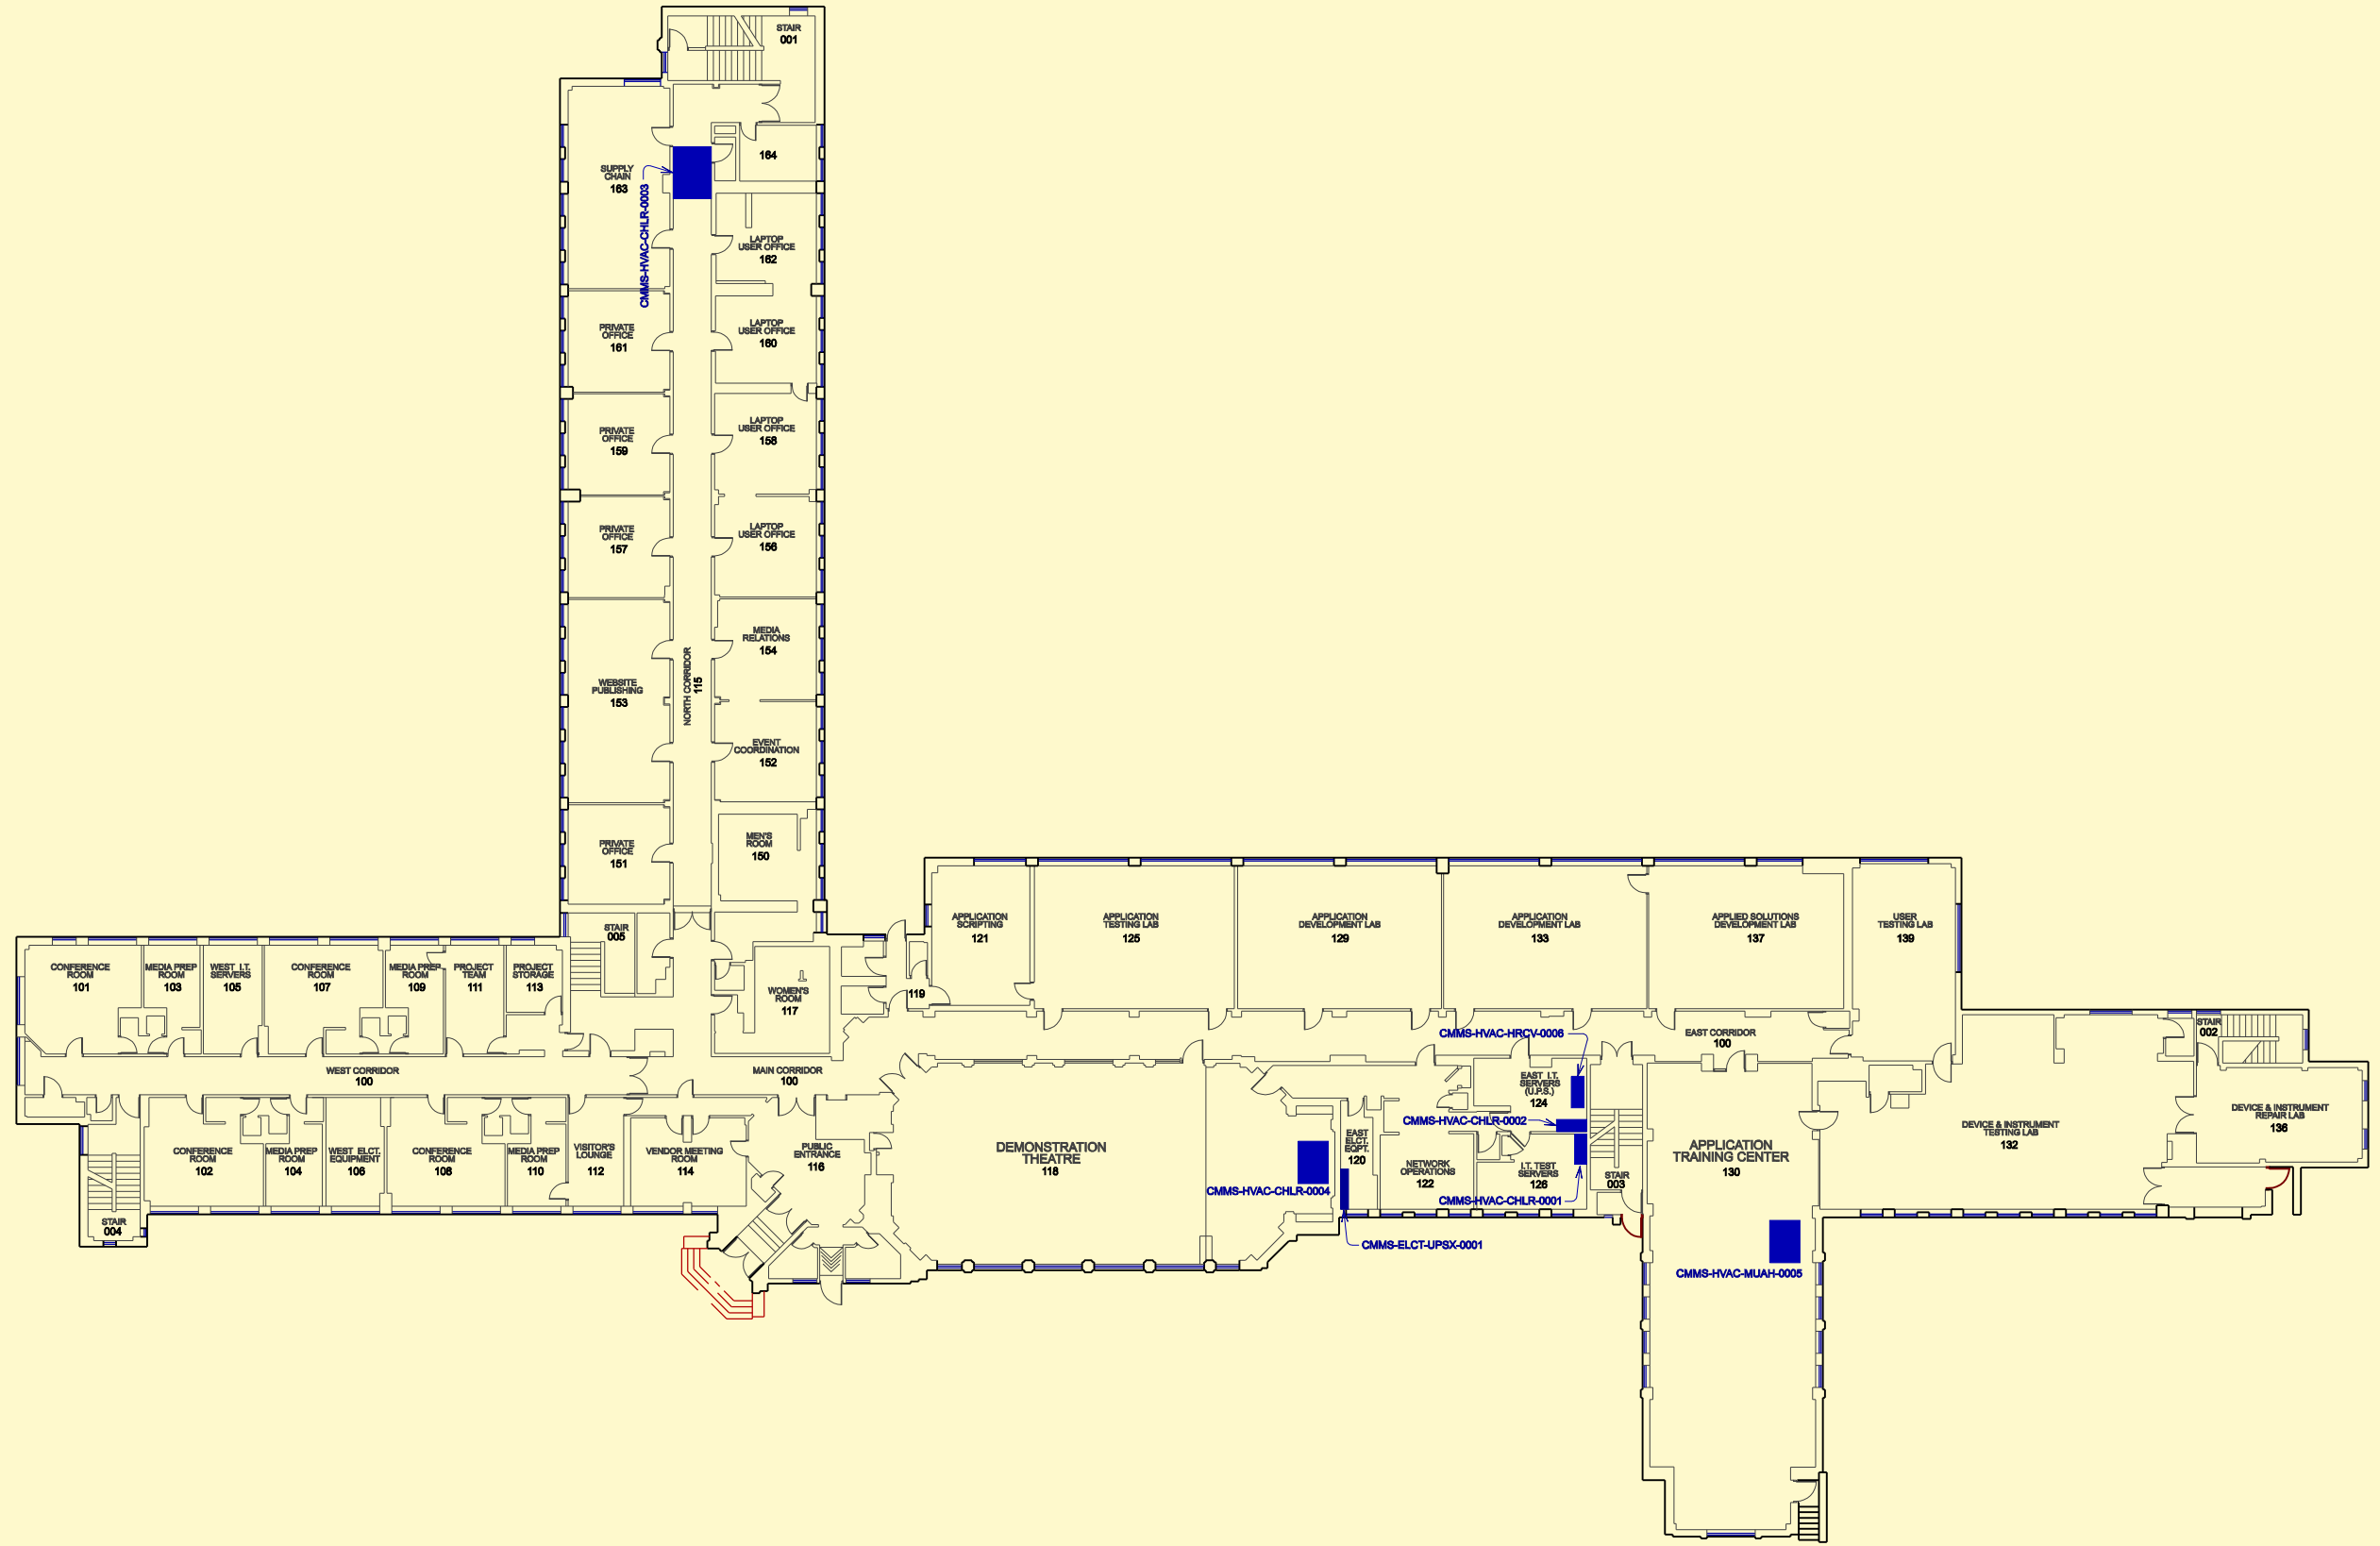

(N.T.S.)

FIRST FLOOR PLAN
INTEGRATED SOLUTIONS INSTITUTION
RESEARCH & DEVELOPMENT CENTER